




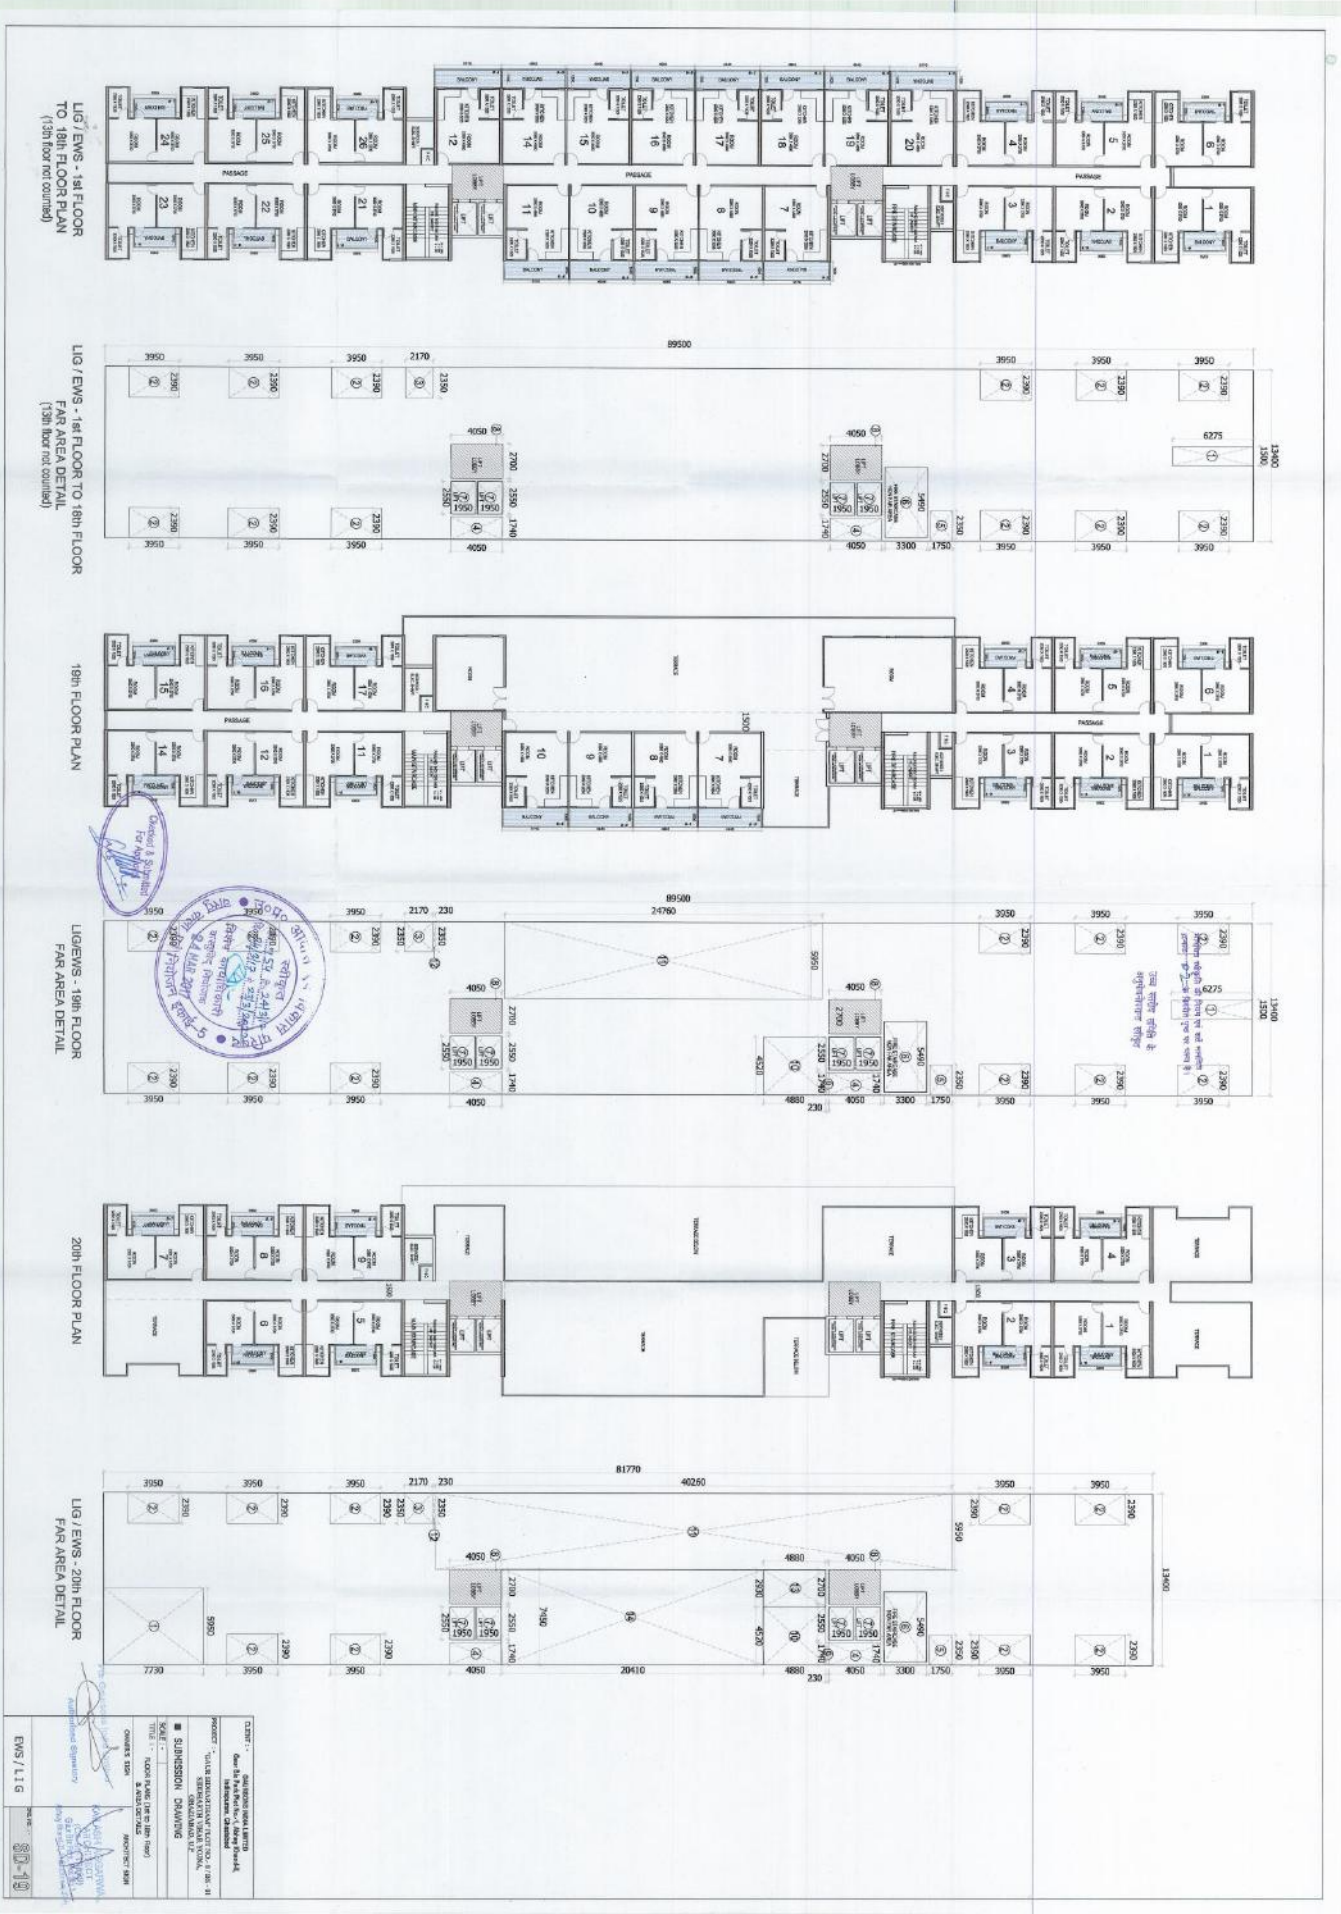


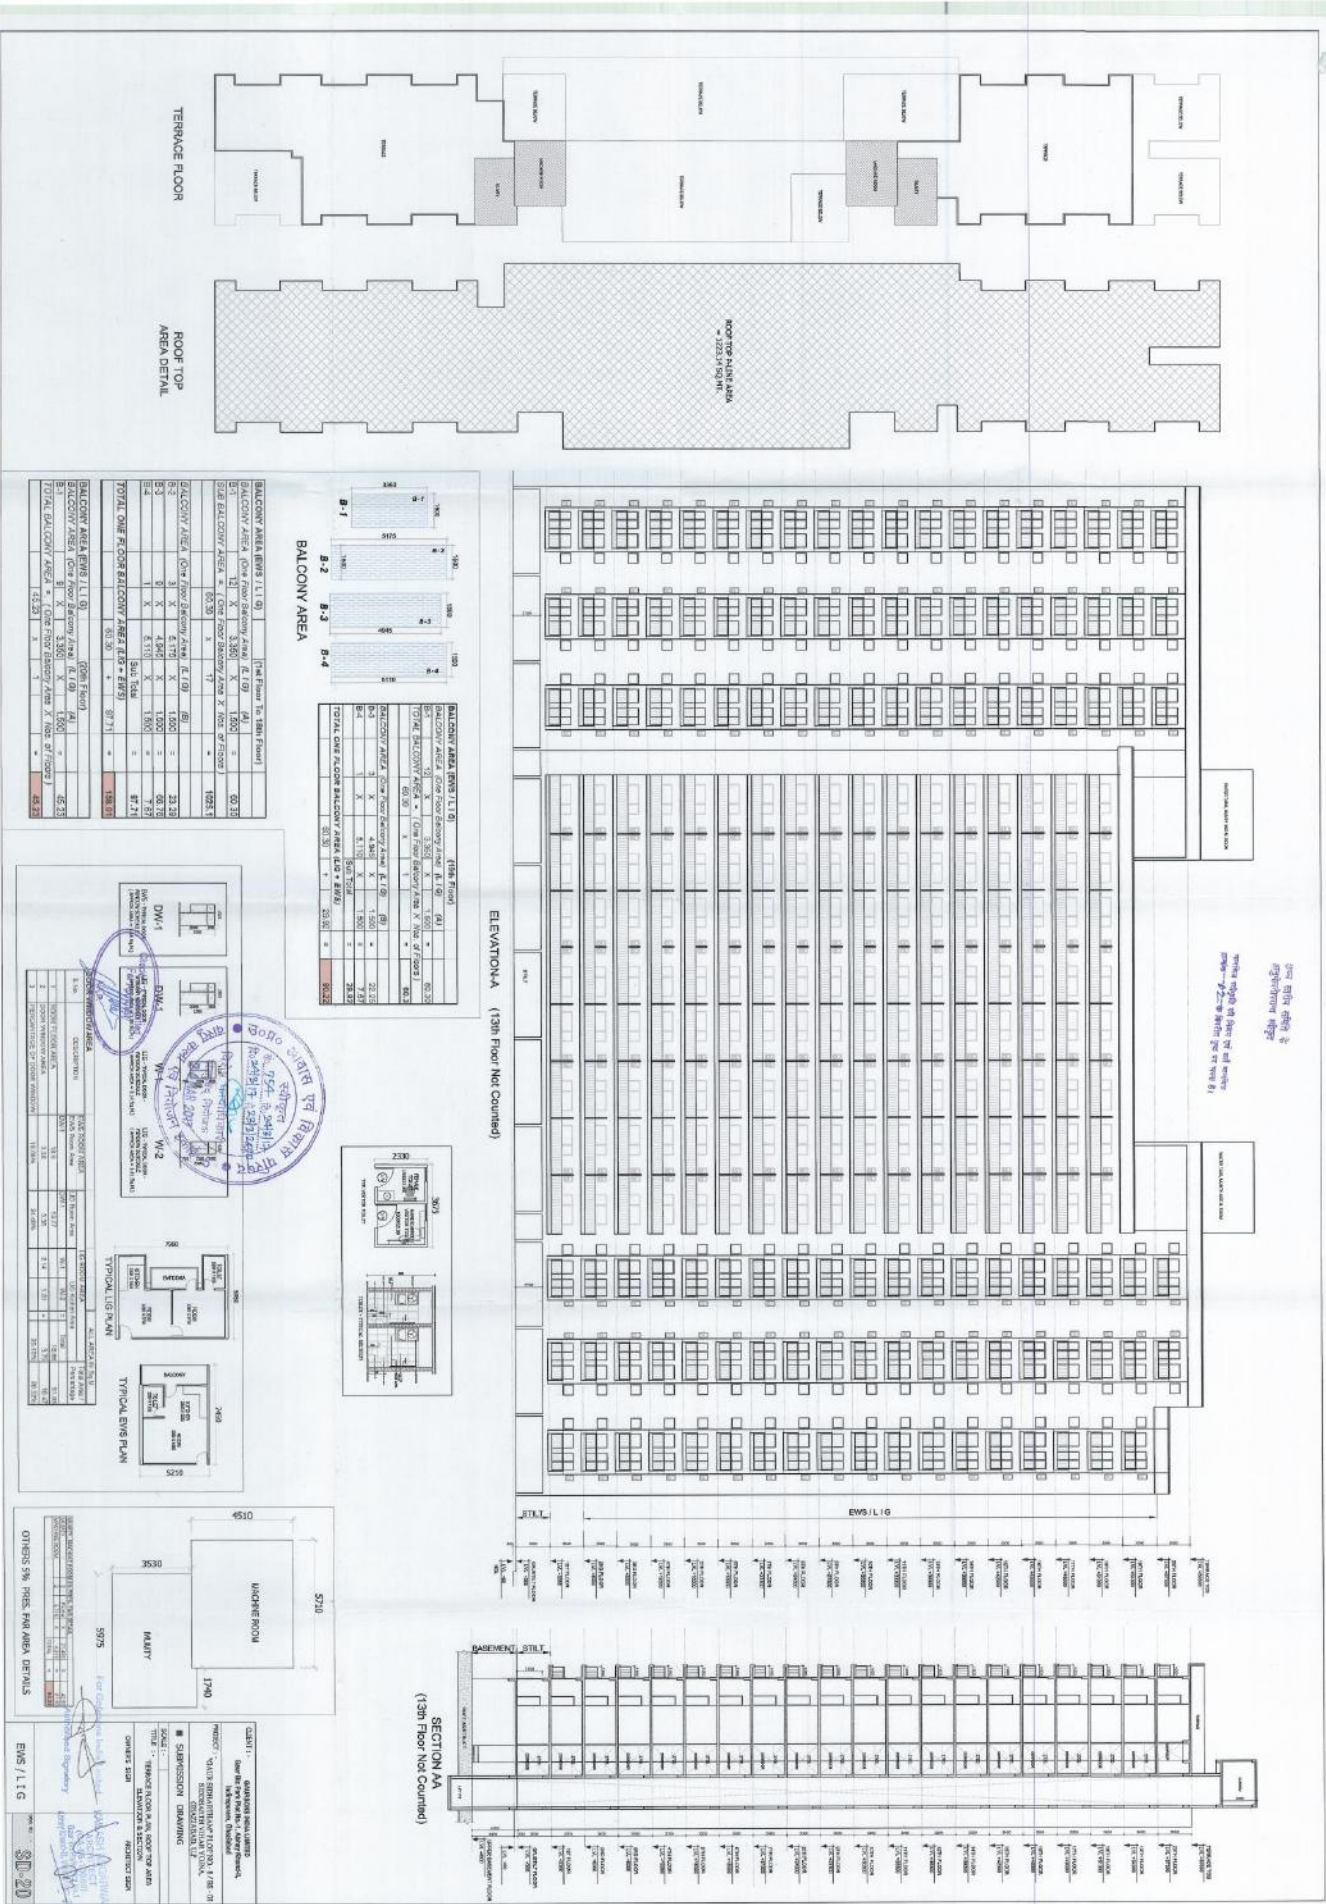



BAGGING - AIRFUEL		S.O.H		B. FRESHENED FAN	
BAGGING - 11/26/2016 DATA					
1	X	20.50	X	12.95	333.34
2	X	18.17	X	8.88	118.08
3	X	20.81	X	37.15	97.52
4	X	12.83	X	17.87	11.95
TOTAL 1200 HRS.				118.81	
LESS AIRFUEL	X	3.00	X	2.65	8.55
UPL. COMB	X	3.97	X	2.86	10.50
UPL. COMB	X	3.42	X	74.75	74.15
GRN	X	1.92	X	1.00	0.75
GRN	X	1.92	X	1.00	0.75
TOTAL FAN HRS. = TOTAL AIRFUEL (-) TOTAL LESS AIRFUEL				104.35	
TOTAL BAGGING 7 FAN				104.35	
BAGGING 1 HOUR MAX TOTAL				11.82	

0.0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2	2.3	2.4	2.5	2.6	2.7	2.8	2.9	3.0	3.1	3.2	3.3	3.4	3.5	3.6	3.7	3.8	3.9	4.0	4.1	4.2	4.3	4.4	4.5	4.6	4.7	4.8	4.9	5.0	5.1	5.2	5.3	5.4	5.5	5.6	5.7	5.8	5.9	6.0	6.1	6.2	6.3	6.4	6.5	6.6	6.7	6.8	6.9	7.0	7.1	7.2	7.3	7.4	7.5	7.6	7.7	7.8	7.9	8.0	8.1	8.2	8.3	8.4	8.5	8.6	8.7	8.8	8.9	9.0	9.1	9.2	9.3	9.4	9.5	9.6	9.7	9.8	9.9
-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----



MULTIPLY MACHINE ROOM 5% PRES. F&R DETAIL			
MULTIPLY 1	1	0.800	X
			4.000
			=
MULTIPLY 2	1	4.460	X
			6.397
			=
MULTIPLY 3		3.945	X
			6.230
			=
MACHINE ROOM	1	3.460	X
			3.080
			=
			10.69
			=
			91.33

ROOF TOP AREA DETAIL			=	2237.01
TOTAL AREA (F+PINE)				
NON FAR AREA DETAIL		Floors		
FIRE STAIRCASE (S IN-2)	17.28	X	7	120.96
			=	
TOTAL NON FAR AREA			=	120.96

